


**SECTION B - B**

**SECTION A - A**

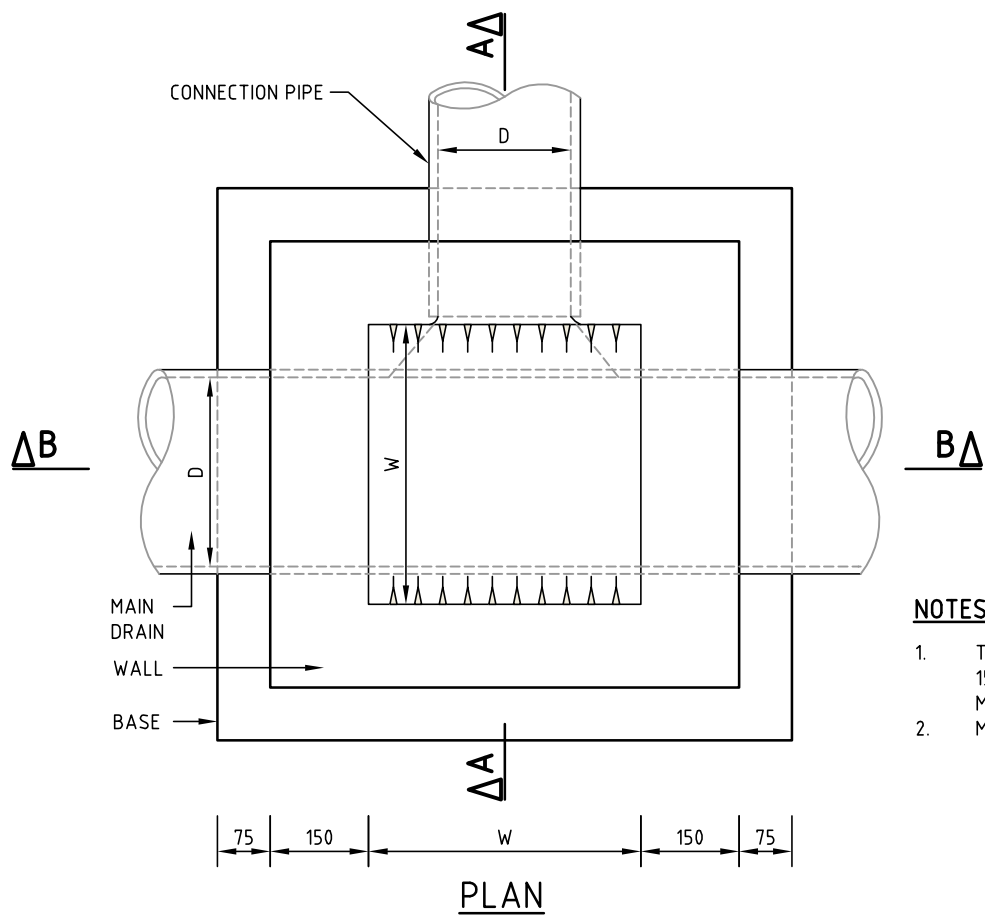

**PLAN**

**NOTES:**

1. THE WALLS AND SLAB OF THE PIT SHALL BE 150mm CONCRETE REINFORCED WITH SL82 MESH PLACED CENTRALLY
2. MINIMUM CONCRETE STRENGTH  $f'c=32MPa$

NOT TO SCALE

**ENGINEERING SERVICES BRANCH**



**JUNCTION CHAMBER  
FOR DRAINAGE  
CONNECTIONS**

Approved By		Drawing Number	1P 50318
Principal Engineer Infrastructure	Manager Engineering Services	Revision	E
Date Nov, 2010	Date Nov, 2010	Docs Number	