


SECTION

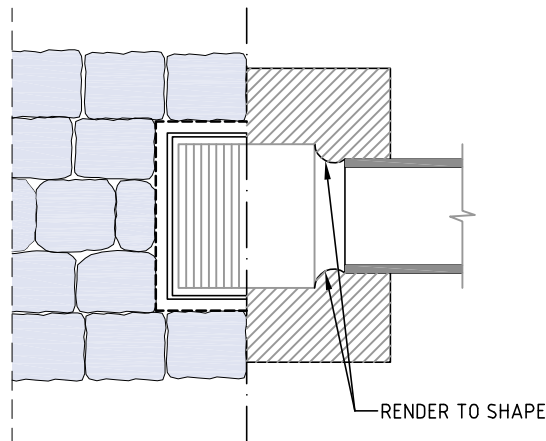

HALF PLAN HALF SECTION

NOTES:

1. END OF ENTRY PIPE IS TO BE CUT OFF AND TRIMMED SO THAT IT IS AT LEAST 50mm FROM INSIDE WALL SURFACE OF PIT.
2. NO DEBRIS OF ANY KIND IS TO BE LEFT IN DRAIN.
3. MINIMUM CONCRETE STRENGTH $f'c=32MPa$

NOT TO SCALE

ENGINEERING SERVICES BRANCH



CITY OF MELBOURNE

**STANDARD LANE
TYPE PIT**

Approved By

Principal Engineer
Infrastructure

Date Nov, 2010

Manager
Engineering Services

Date Nov, 2010

Drawing
Number

1P 50310

Revision

E

Docs
Number